



Emplacement next to the transformer pit (if possible).


A PLAN
SCALE NTS.

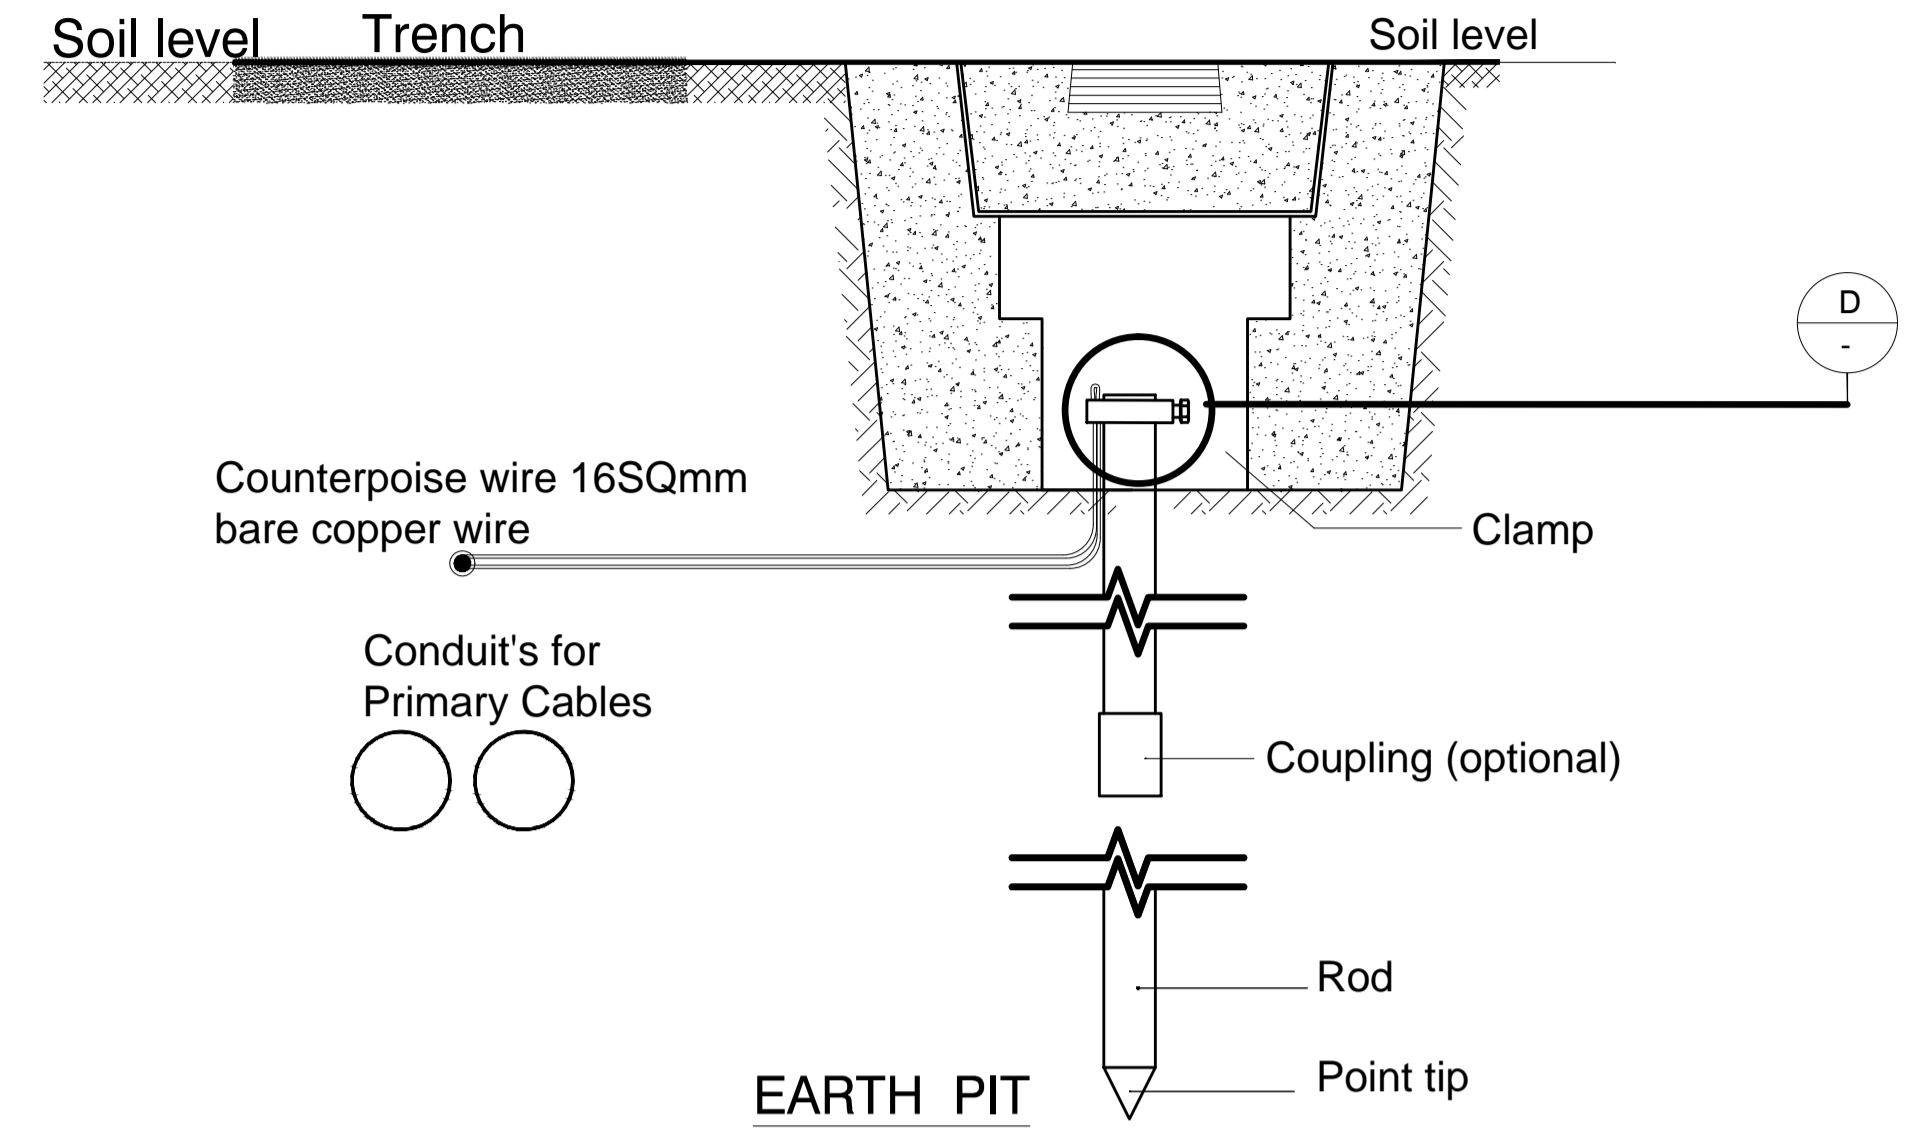

C BLOW UP DETAIL-C
SCALE NTS.

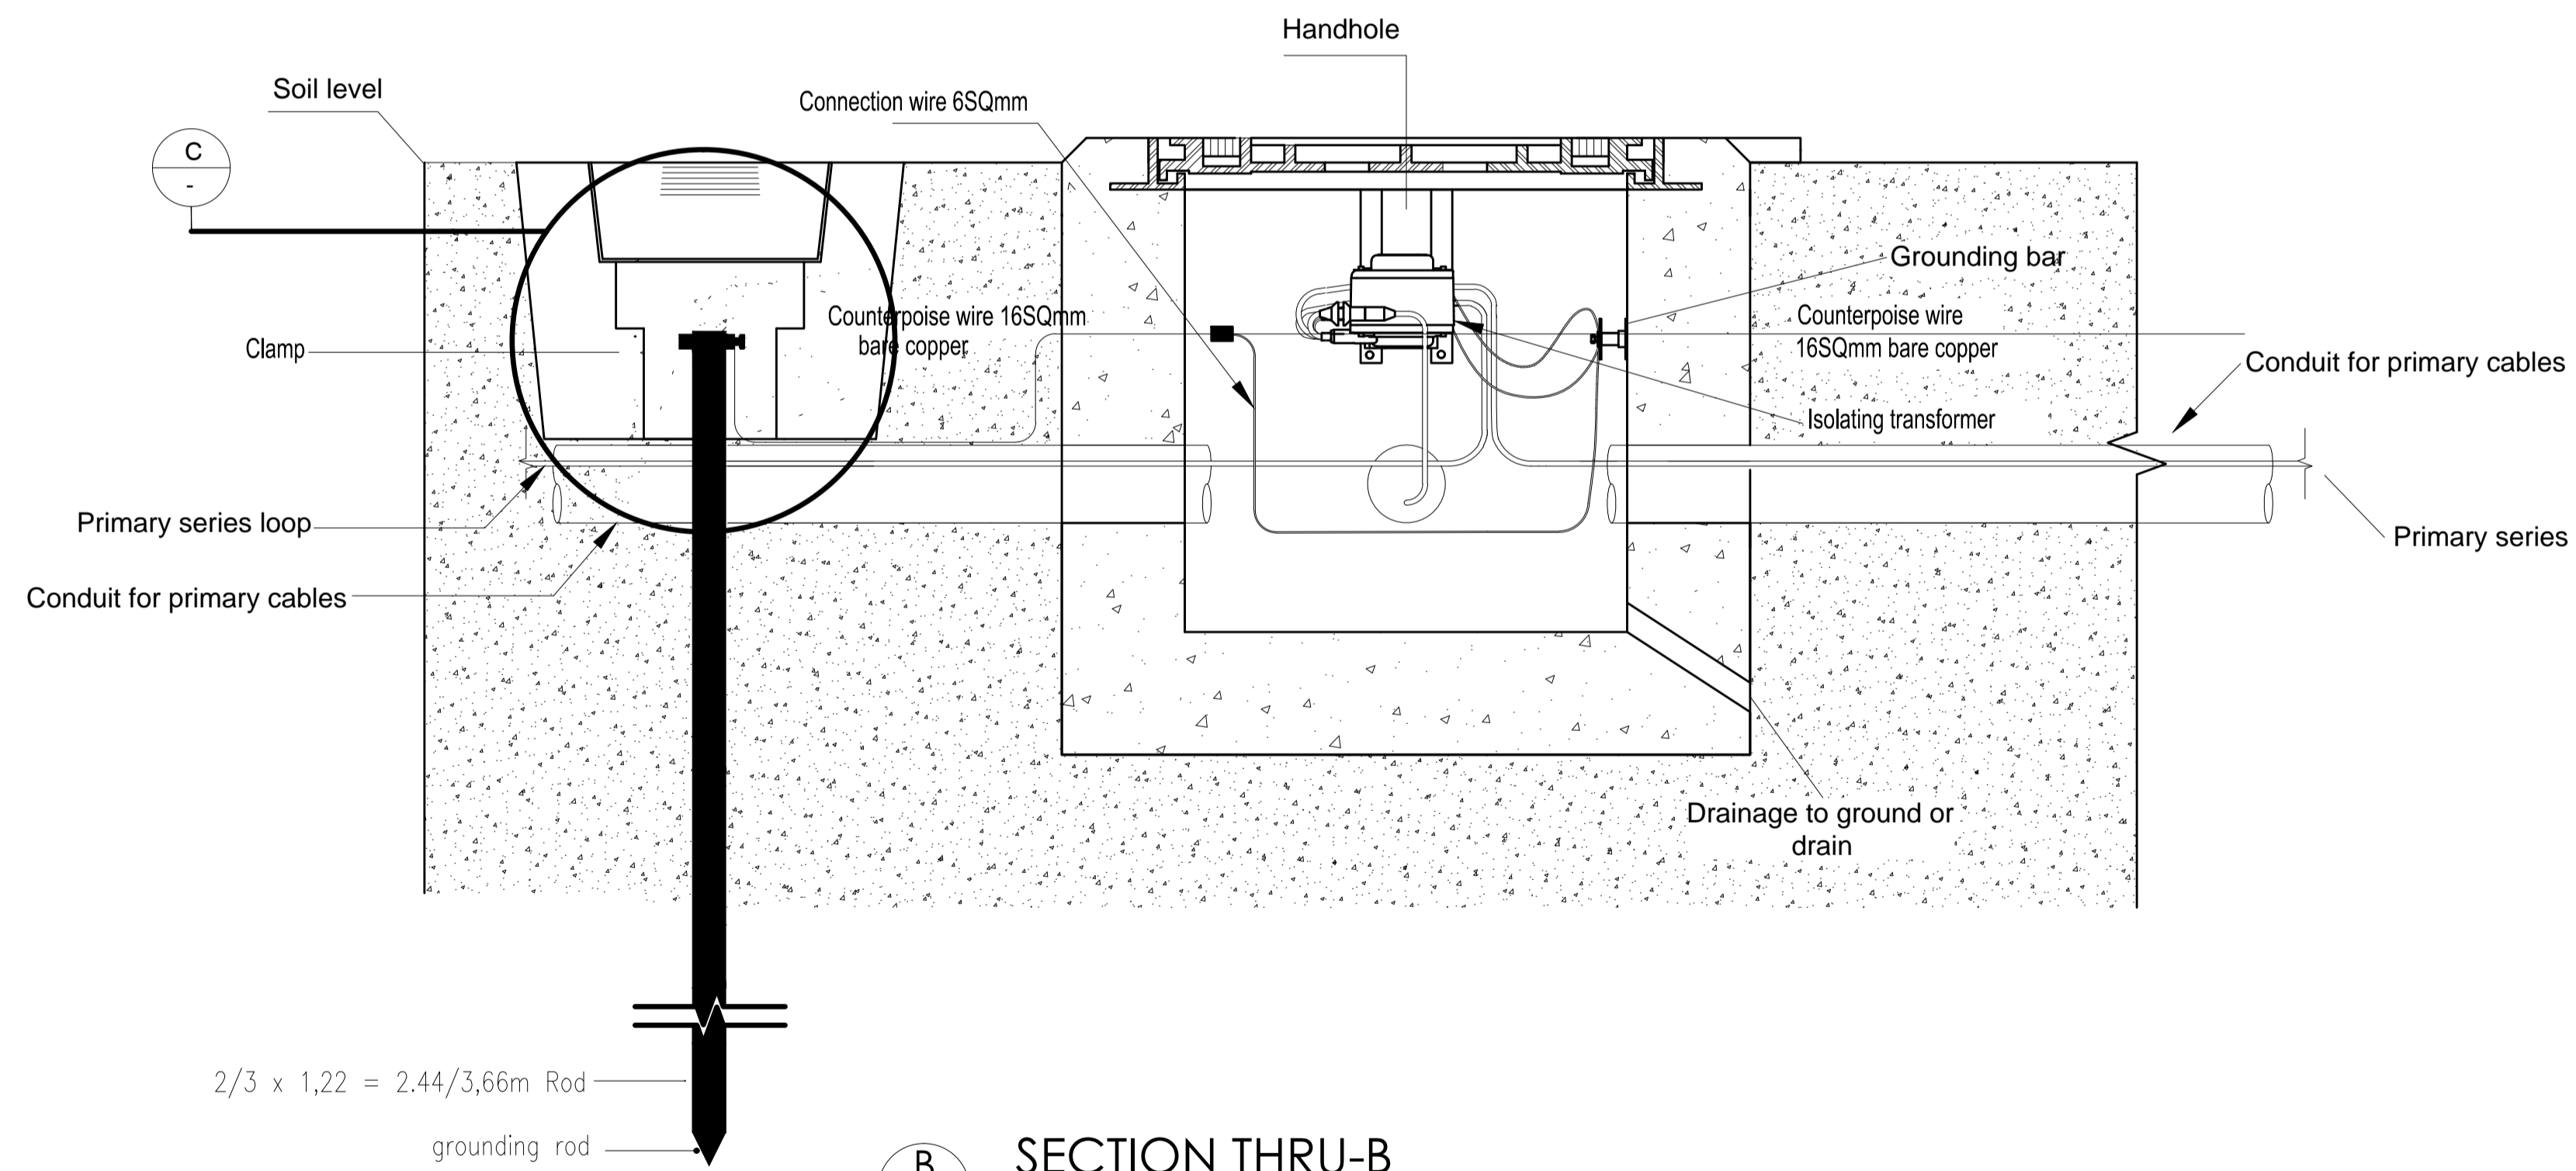

B SECTION THRU-B
SCALE NTS.

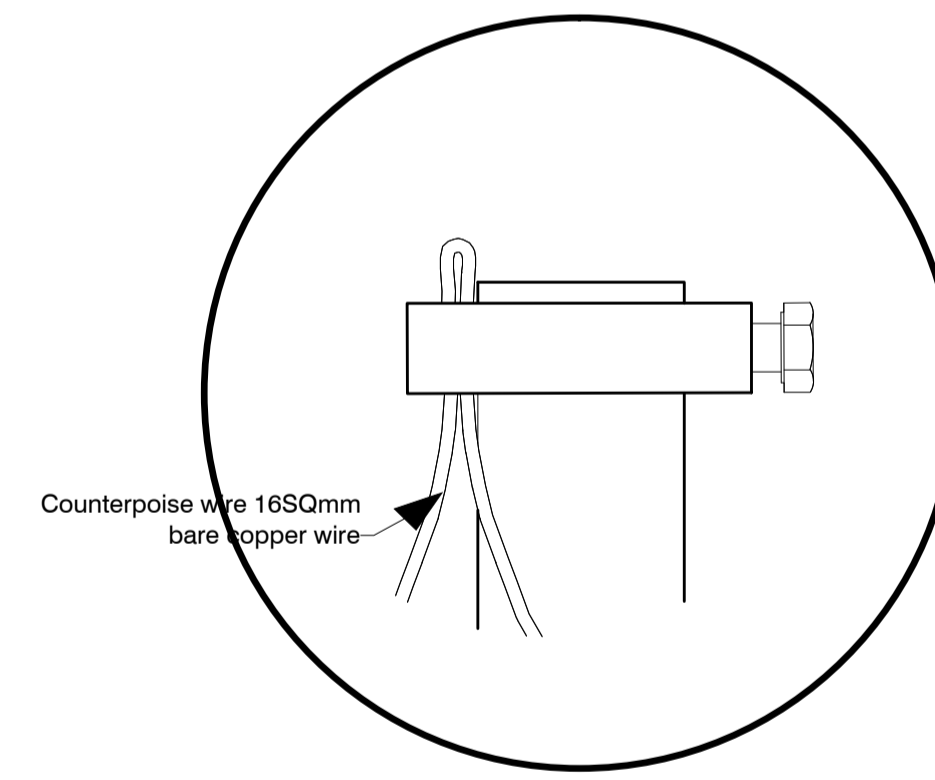

D BLOW-UP DETAIL-D
SCALE NTS.

NOTE:
Grounding or counterpoise wire should only be cut when it is unavoidable.

GROUNDING ROD DETAILS AND COUNTERPOISE
SCALE NTS.

NOTE:
1. IF THIS DRAWING HAS BEEN RECEIVED ELECTRONICALLY, IT IS THE RECIPIENTS RESPONSIBILITY TO PRINT THE DOCUMENT TO THE CORRECT SCALE.
2. THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.
3. ALL DIMENSION IN METER UNLESS OTHERWISE SHOWN.

CONSULTANTS: Urban Integrated Consultants, Inc. UICI Corporate Bldg., 8 Landa Street, VASRA, Diliman, Quezon City, 1128	DRAWN BY: C.M.L.	SUBMITTED BY:	 CLARK INTERNATIONAL AIRPORT CORPORATION	RECOMMENDING APPROVAL:	APPROVED BY:	PROJECT TITLE :	PROJECT TITLE :	DRAWING STATUS: FINAL	SET NO.	SHEET NO.
	CHECKED BY: J.Q.G.	EFREN L. DAVID PRESIDENT - UICI		JAIME ALBERTO C. MELO VICE PRESIDENT AIRPORT OPERATION MANAGEMENT GROUP	ALEXANDER S. CAUGUIRAN PRESIDENT / CHIEF EXECUTIVE OFFICER	CONSTRUCTION OF THE HORIZONTAL INFRASTRUCTURE PROJECT OF THE CLARK INTERNATIONAL AIRPORT NEW TERMINAL BUILDING PROJECT (FORMERLY CLARK AIRPORT LOW COST TERMINAL)	CONSTRUCTION OF THE HORIZONTAL INFRASTRUCTURE PROJECT OF THE CLARK INTERNATIONAL AIRPORT NEW TERMINAL BUILDING PROJECT (FORMERLY CLARK AIRPORT LOW COST TERMINAL)	REVISION Δ : JULY 09, 2018	REVISION Δ : JULY 16, 2018	TA-12
DWGS. CHK. BY: A.T.C.	SHEET CONTENTS: GROUNDING ROD DETAILS AND COUNTERPOISE			DATE: JULY, 2018						