




**COB PROPOSED IMPROVEMENT LAYOUT**  
 SCALE 1:100 MTS.

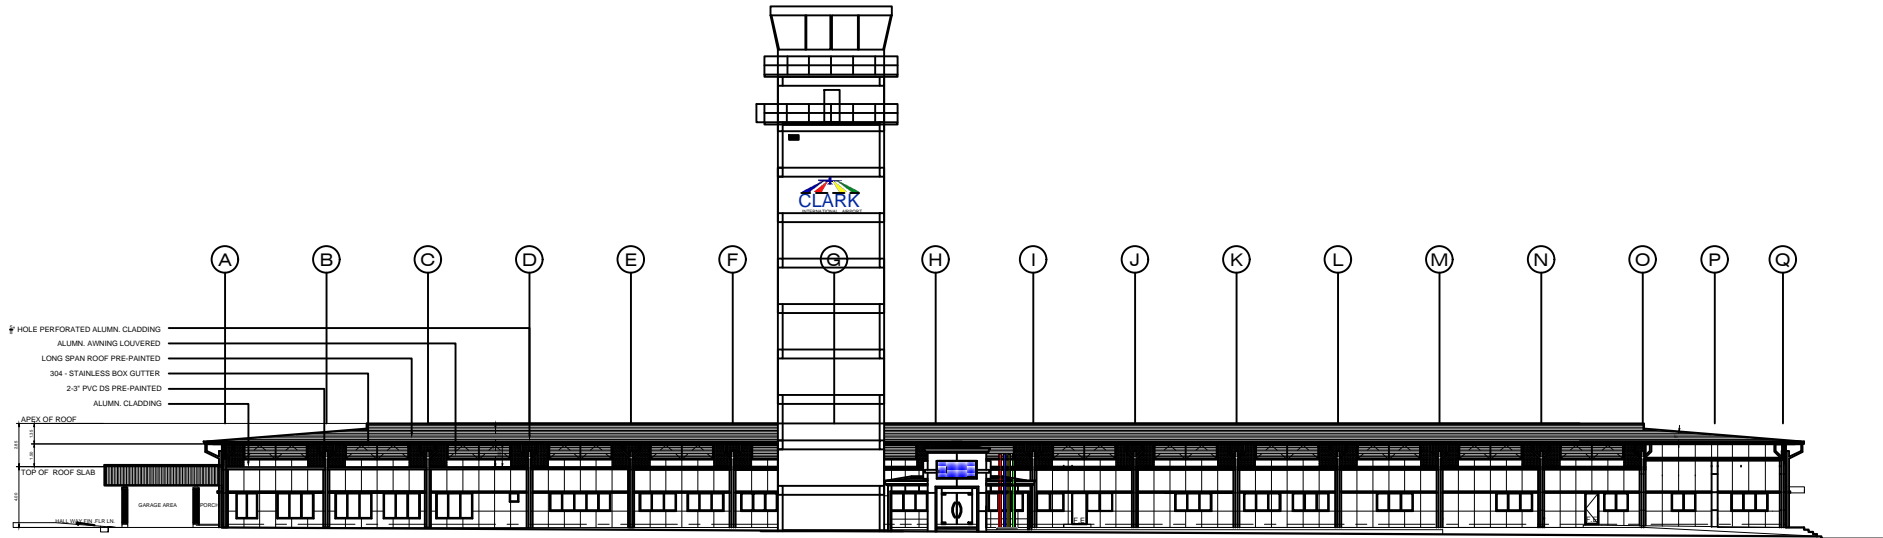

FRONT ELEVATION  
 SCALE 1:100 MTS.

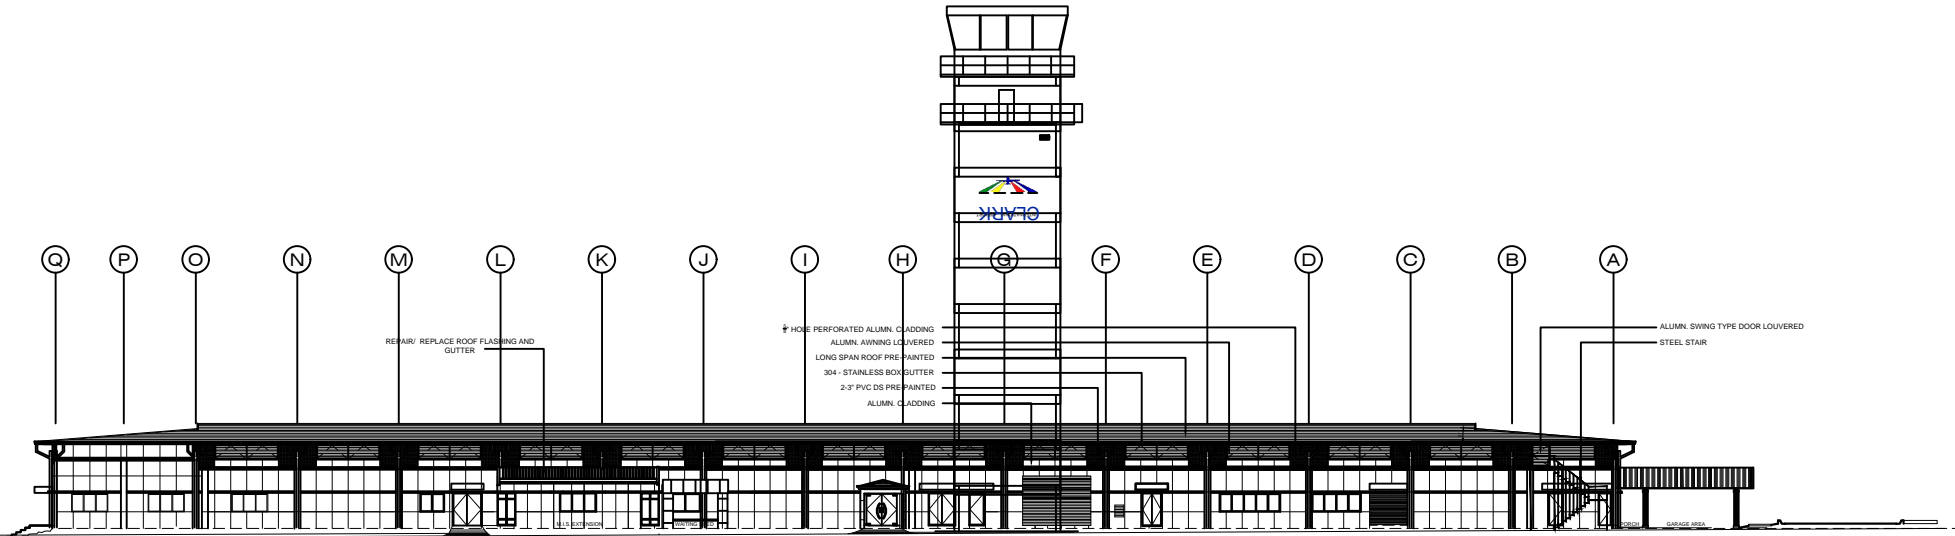



REAR ELEVATION  
 SCALE 1/8" = 1'-0"

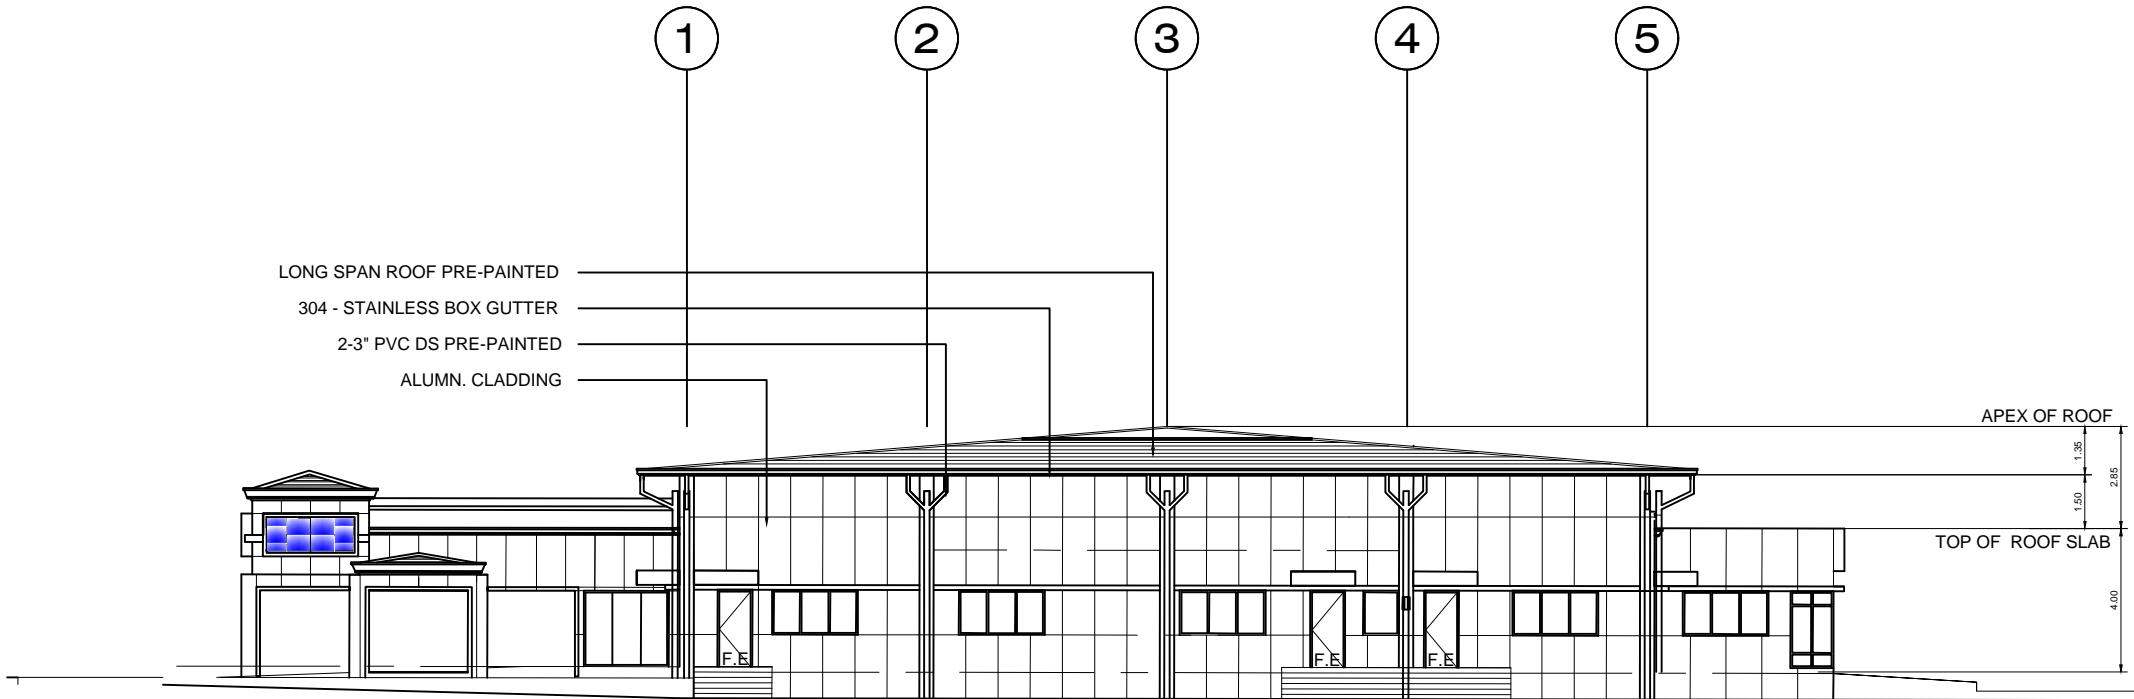


○ **RIGHT SIDE ELEVATION**


SCALE 1:200 MTS.

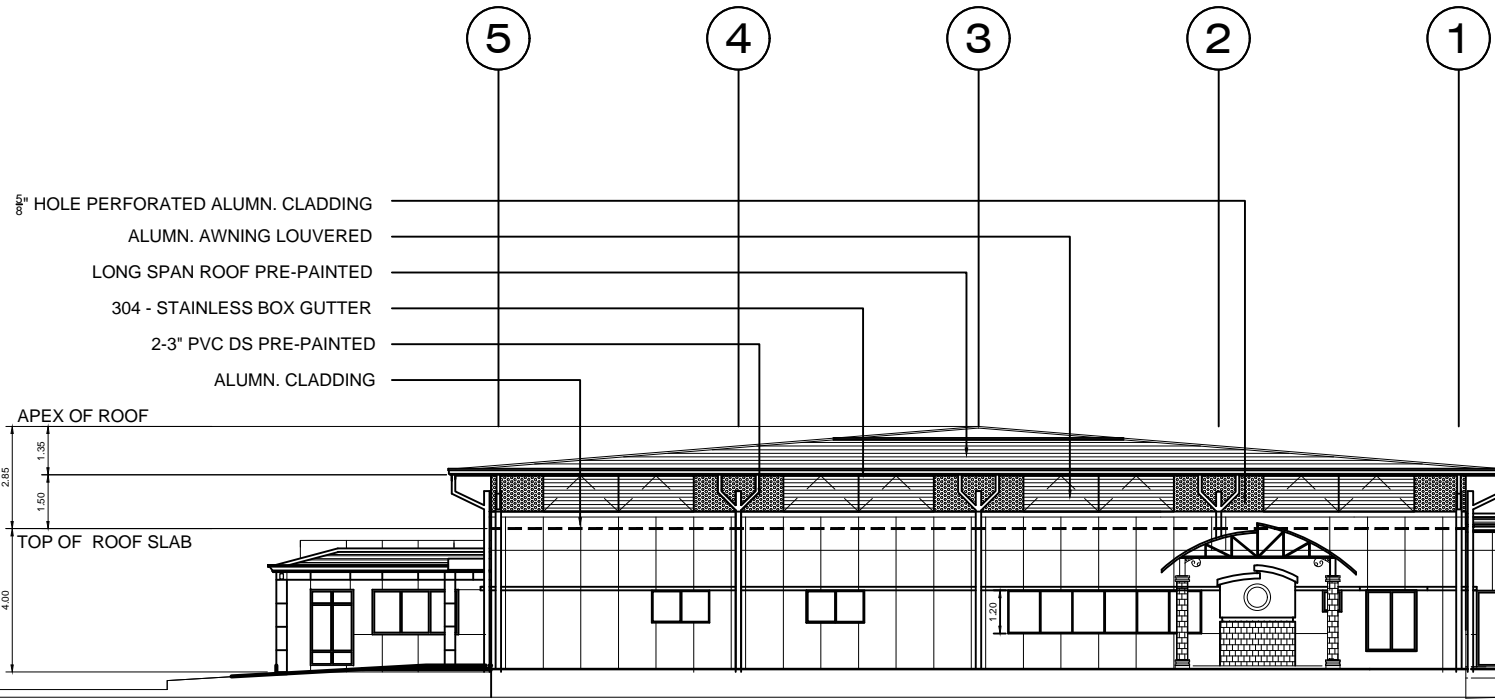



**LEFT SIDE ELEVATION**  
 SCALE 1: 200 MTS.

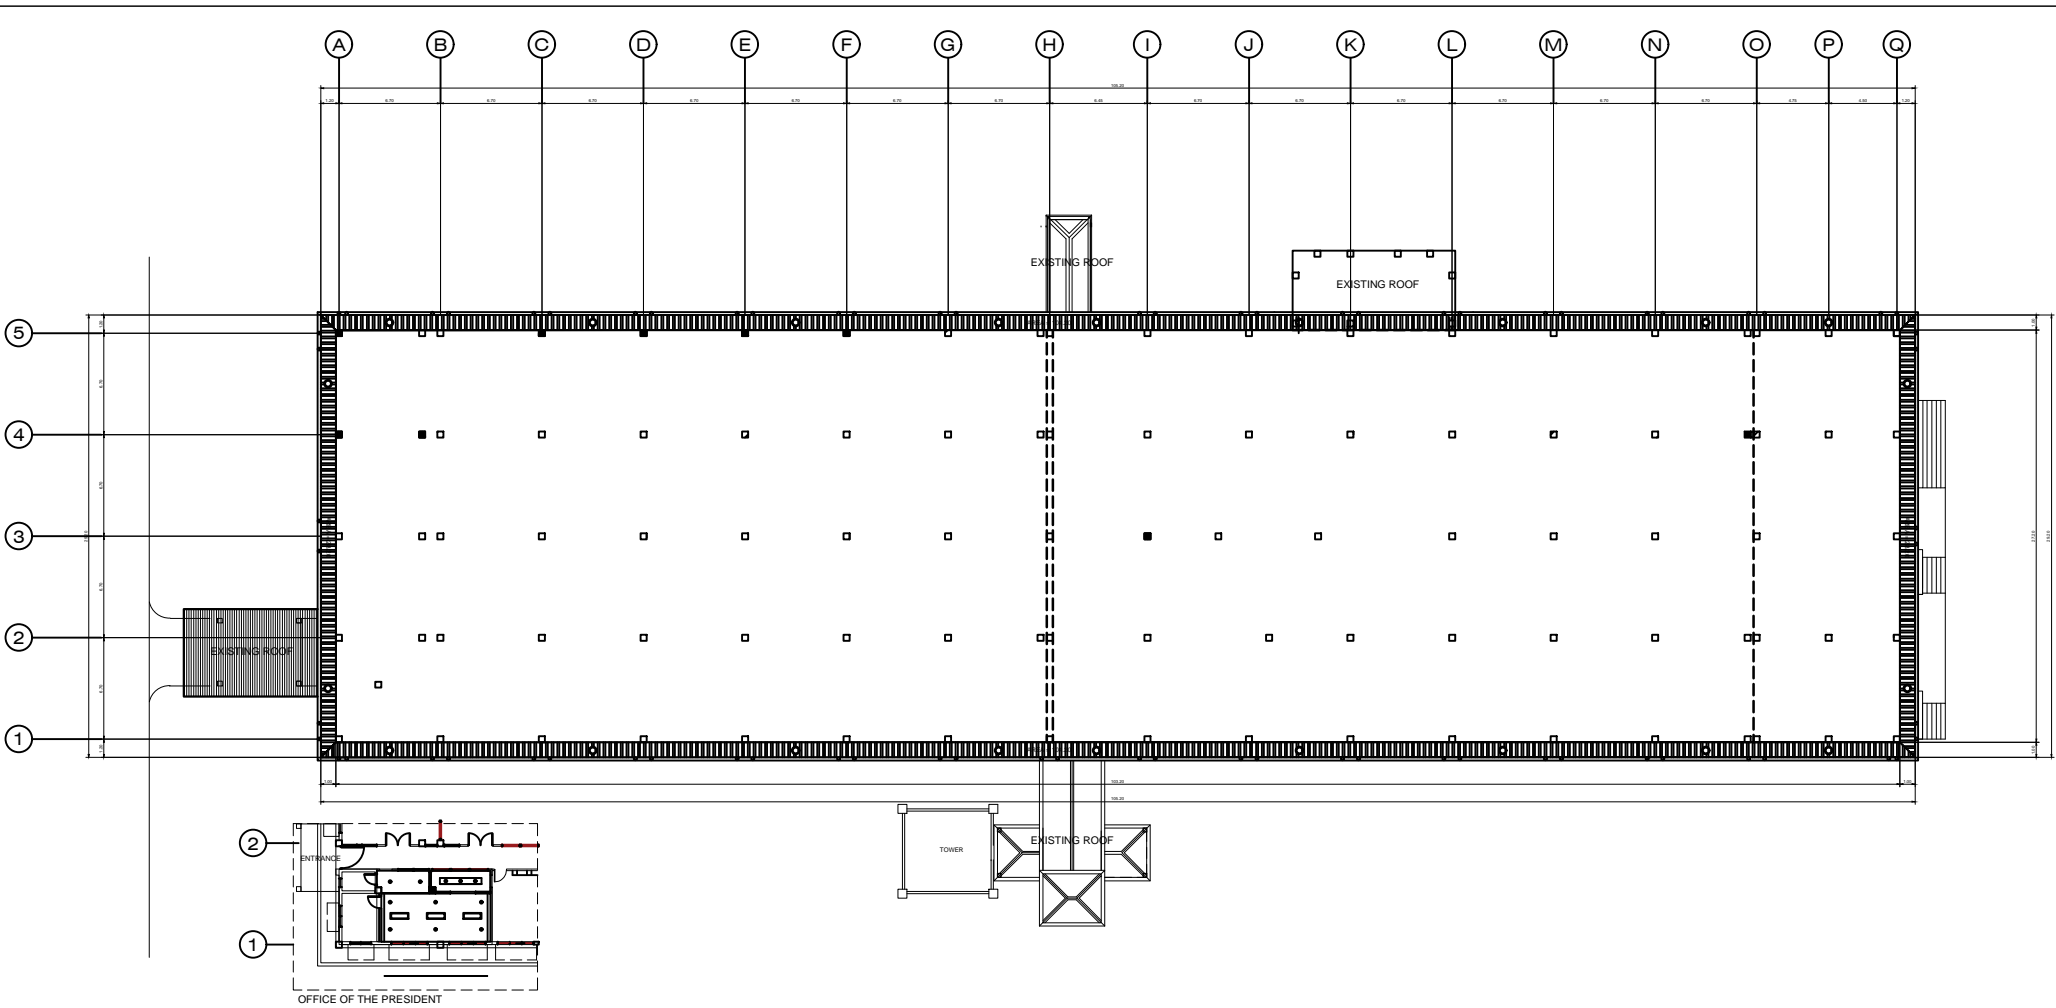

TOTAL AREA = 264.80 SQM. (SPANDREL)  
**CEILING PLAN LAYOUT**  
 SCALE 1:100 MTS.

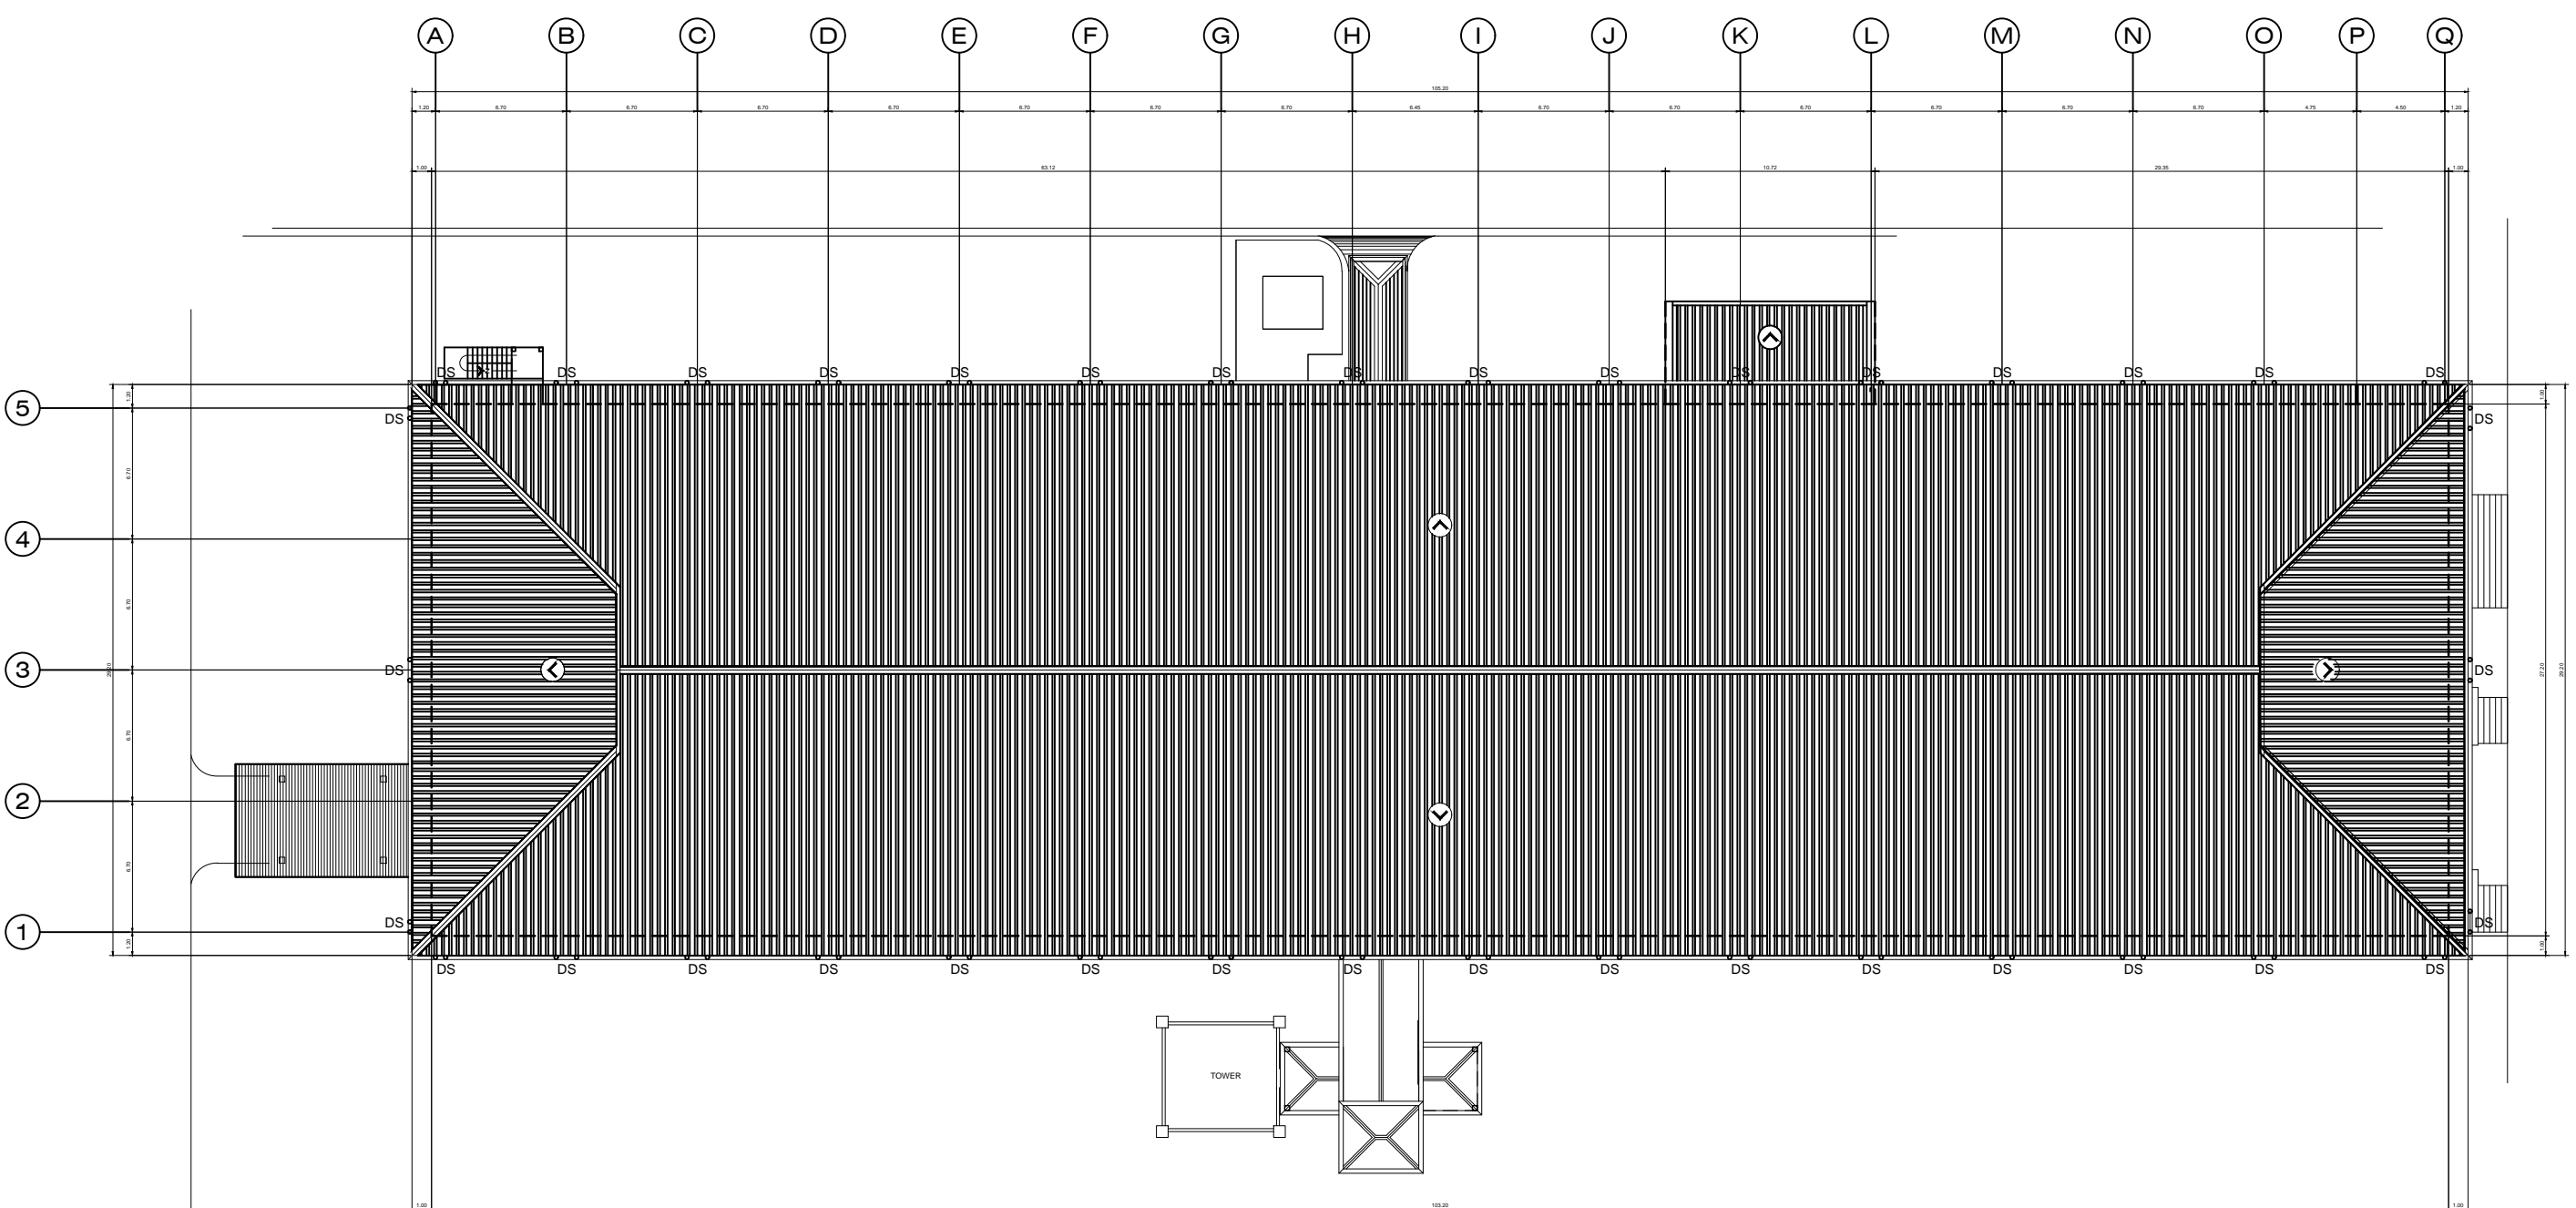


**ROOF PLAN LAYOUT**  
 SCALE 1:100 MTS.

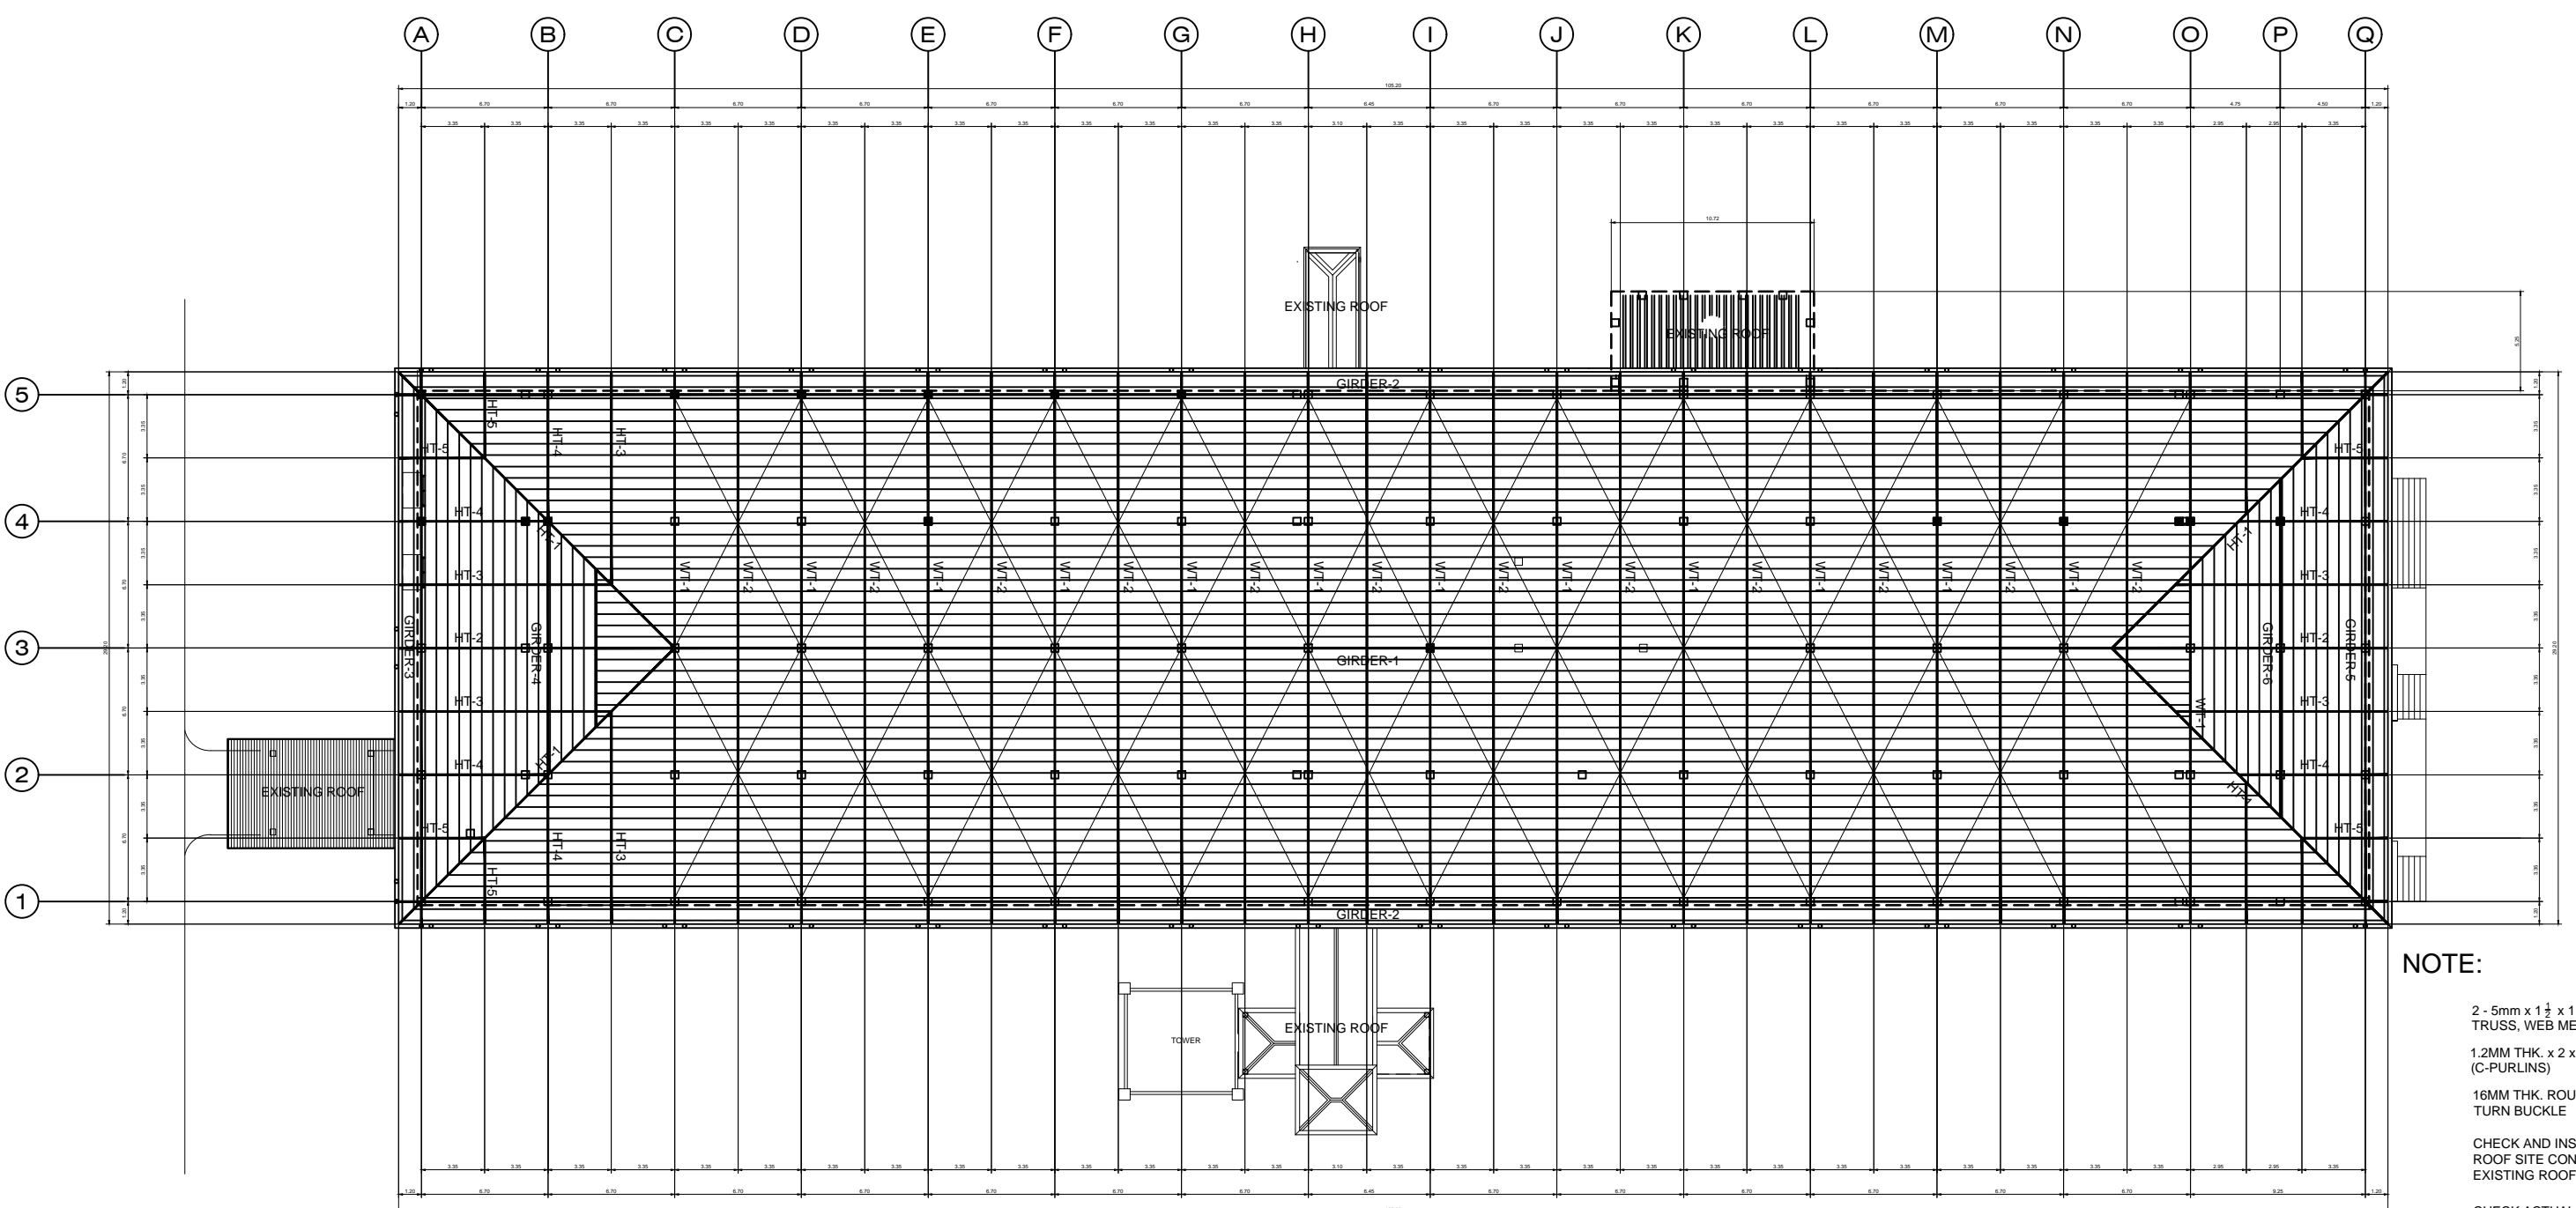

**NOTE:**




- 2 - 5mm x 1 1/2 x 1 1/2 ∠ BAR FOR THE MAIN TRUSS, WEB MEMBER & GIRDER
- 1.2MM THK. x 2 x 4 x 20 - GALVANIZED (C-PURLINS)
- 16MM THK. ROUND STEEL SOG ROD with TURN BUCKLE

CHECK AND INSPECT THE ACTUAL ROOF SITE CONDITION FOR THE SLOPE EXISTING ROOF SLAB

CHECK ACTUAL LOCATION OF EXISTING CONCRETE PAD (ACU CONDENSING UNIT), ELECTRICAL PIPE CHASE AND BREAKERS FOR THE MAIN TRUSS BOTTOM CHORD


**ROOF FRAMING LAYOUT**  
 SCALE 1:100 MTS.



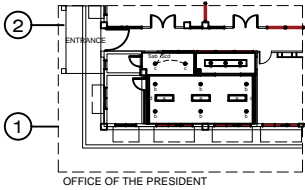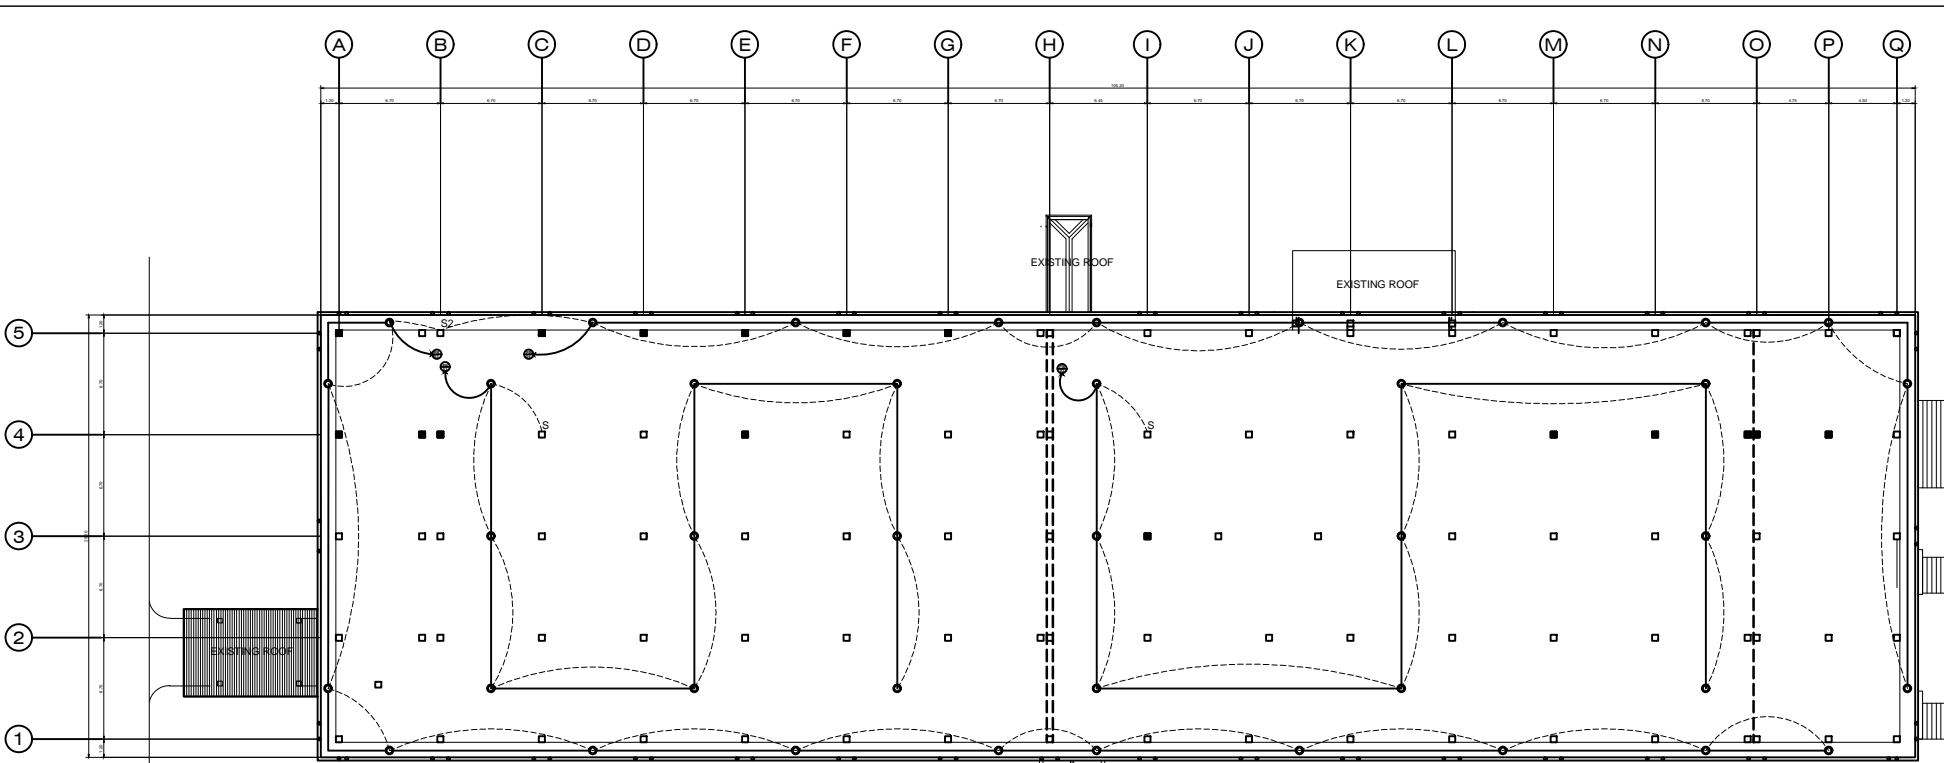

NOTE:  
 THE LOCATION OF THE LIGHTING SWITCHES MUST BE ABOVE (1.20M) FROM THE FIN. FLOOR LINE OR ANY APPROVED EQUAL

LIGHTING LINE LAYOUT  
 SCALE 1:100 MTS.

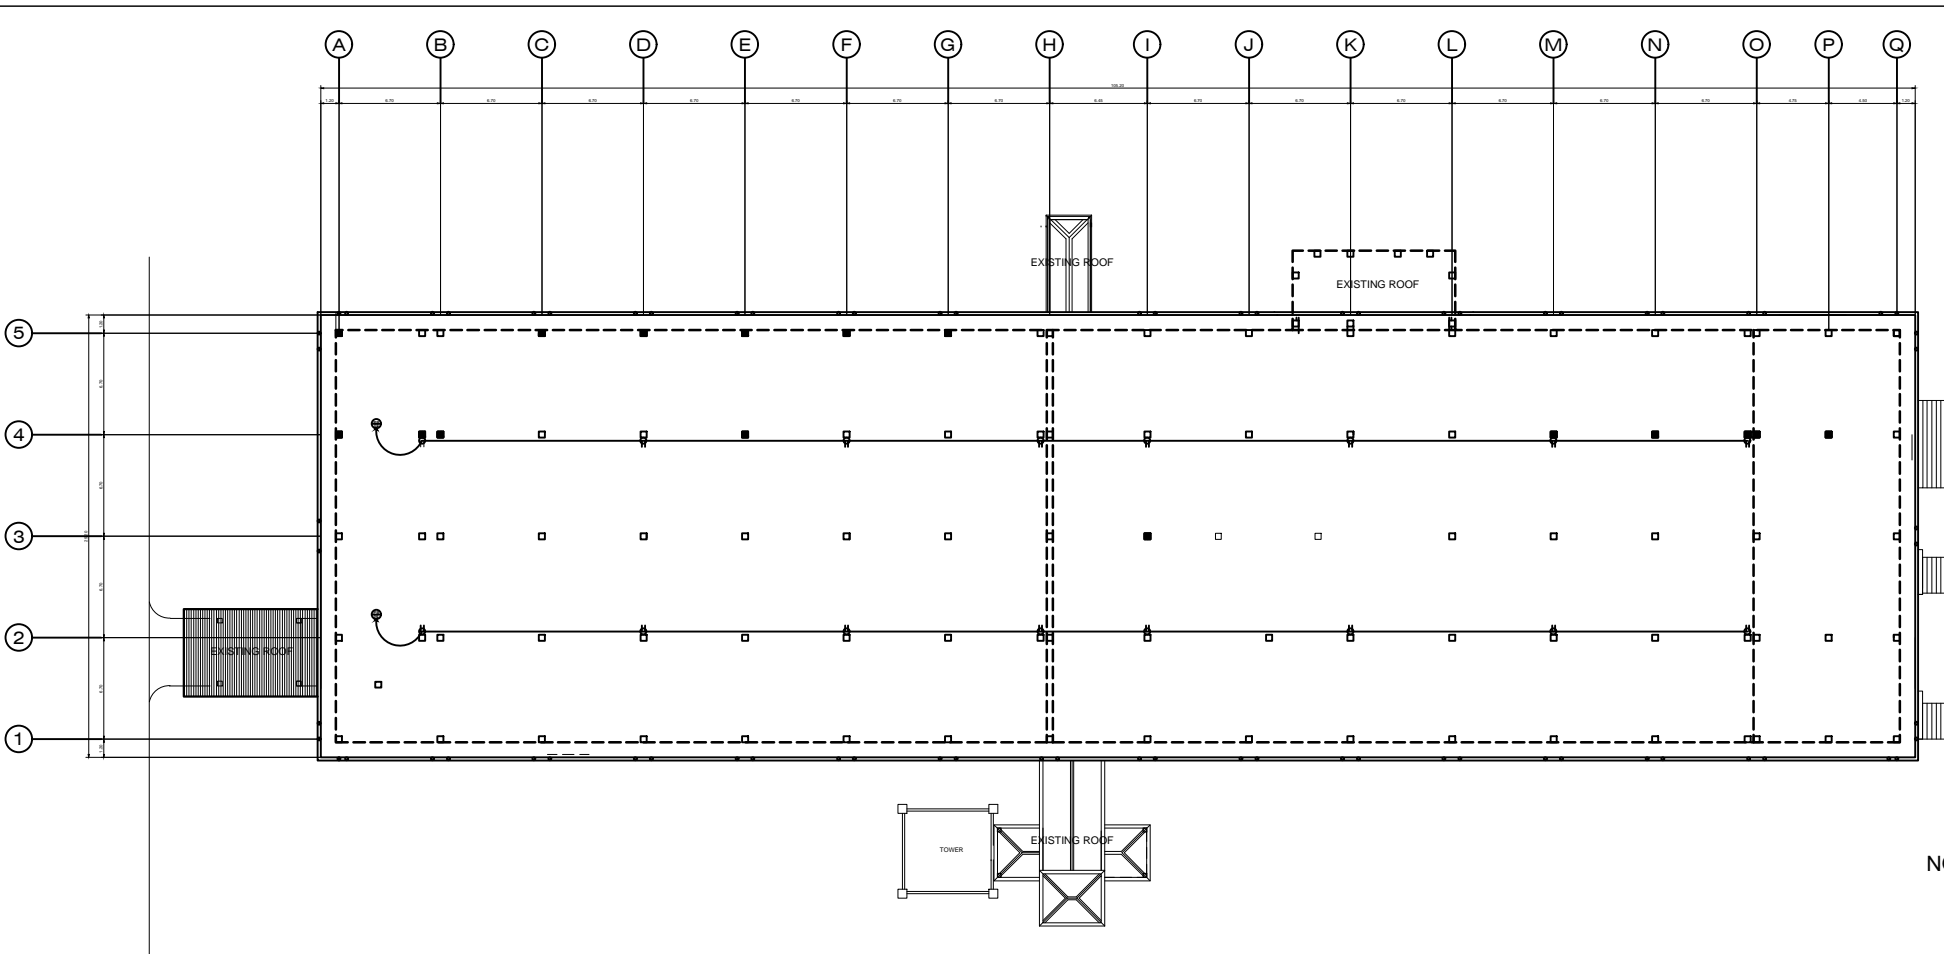

**NOTE:**

THE LOCATION OF THE CONV. OUTLET MUST BE ABOVE (0.40M) FROM THE FIN. FLOOR LINE

THE CONV. OUTLET ARE MOUNTED ON THE WEB MEMBER OF THE TRUSS OR ANY APPROVED EQUAL

**POWER LINE LAYOUT**  
 SCALE 1:100 MTS.